

# DOL 104 0-3 V Humidity Sensor



For other language variants of this document we refer to [www.dol-sensors.com](http://www.dol-sensors.com) or your local dealer.

## 1 Product description


DOL 104 is a high-precision sensor for measuring relative humidity. It is intended for application in livestock houses but is also well suited for a number of industrial applications.

The sensor features one analogue output with full protection against short-circuits and wiring failures.

The special sensor element and the built-in Teflon filter enable application in livestock houses with constantly high humidity.

The sensor is microprocessor-controlled and has a two-color light emitting diode (LED) to communicate the operation status and the error diagnostic.

## 2 Mounting guide

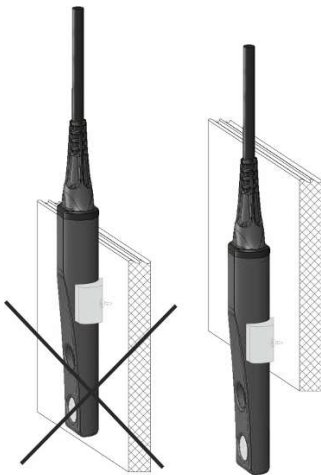

For optimum mounting of the sensor, use mounting clip or mount it free-hanging in the cable.

The sensor element of the sensor requires free air passage.

Mount the sensor so it is not exposed to direct sunlight, as this would affect the measurement.




- Remember to put on a protection cap before mounting the cable.

## 3 Installation guide



Installation, servicing and troubleshooting of all electrical equipment must be carried out by qualified personnel in compliance with the applicable national and international standard EN 60204-1 and any other EU standards that are applicable in Europe.

### 3.1 Connection of the sensor

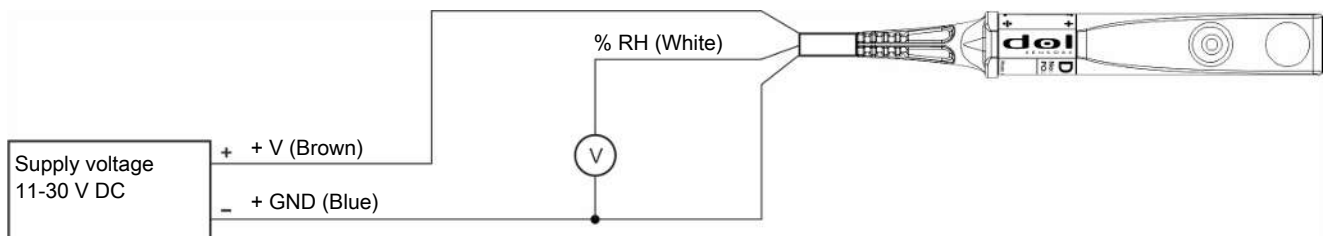


#### Signals and wire colors

DOL 14		DOL 14 HQ		DOL 114 0-10 V		DOL 104 0-3 V
(BK) Black = +13-24 V DC	→	(WH) White = +13-28 V DC	→	(BN) Brown = +11-30 V DC	→	(BN) Brown = +11-30 V DC
(BN) Brown = 0...10 V/%RH	→	(GN) Green 0...10 V/%RH	→	(WH) White = 0...10 V/%RH	→	(WH) White = 0...3 V/%RH
No temperature output	→	No temperature output	→	(BK) Black = 0...10 V/°C	→	No temperature output
(BU) Blue = GND (0 V)	→	(BN) Brown = GND (0 V)	→	(BU) Blue = GND (0 V)	→	(BU) Blue = GND (0 V)

LED/LIGHT PROTOCOL		Functional graph	
<b>LED</b>		<b>Status</b>	
<b>Green</b>	<b>Red</b>		
ON		Operation OK	
Flash		Outside normal range (below 10 % RH or exceeding 95 % RH)	
	ON	Connection error Load < 500 Ω	
	Flash	Sensor defect Over or under voltage alarm Overload	

The graph shows a linear relationship between relative humidity (%RH) on the y-axis and voltage (V) on the x-axis. The y-axis ranges from 0 to 100 in increments of 20. The x-axis ranges from 0 to 3.0 in increments of 0.6. A straight line starts at the origin (0,0) and passes through points (0.6, 20), (1.2, 40), (1.8, 60), (2.4, 80), and ends at (3.0, 100).

## 4 Maintenance



Clean the sensor with water and a brush without using:

- High-pressure cleaner
- Highly compressed air
- Solvents
- Corrosive/caustic agents
- Alcohol-based disinfectants

During cleaning and disinfection, the sensor should be removed and the sealing plug for the cable should be mounted. Alternatively, the sensor protective cap can be mounted. The sensor must be placed with the tip pointing upwards during disinfection.

After the sensor has been exposed to water and condensation, it requires a period where the relative humidity is lower than 80 %RH in order for it to measure correctly.



Do not bend the sensor as this would inflict permanent damage on the electronics of the sensor.

## 5 Technical data

Measurement range	% RH	0 - 100
Accuracy	% RH	± 3% RH (40–85 %) ± 4% RH (10-95 %) at 0-40 °C
Output signal	V	0.03 V / % RH
Time constant	T <sub>63</sub>	20 s at 0.5 m/s air speed
Supply voltage	V DC	11 – 30
Current	mA	12 mA no load 35 mA max. load
Load	Ω	> 500 Ω - < 10 MΩ
Recommended load	kΩ	≥ 100
Max. output current	mA	20
Output impedance	Ω	< 1
Cable		2 m 3 x 22 AWG / 0.34 mm <sup>2</sup>

Max. cable length		200 m 1.50 mm <sup>2</sup>
Temperature, operation and storage	°C	-40 to -60
Protection class	IP	67
Measurement, shipment	mm	275 × 200 × 20
Shipment weight ex. connector	g	150

## 5.1 Dimensions

Dimensions in mm.

